


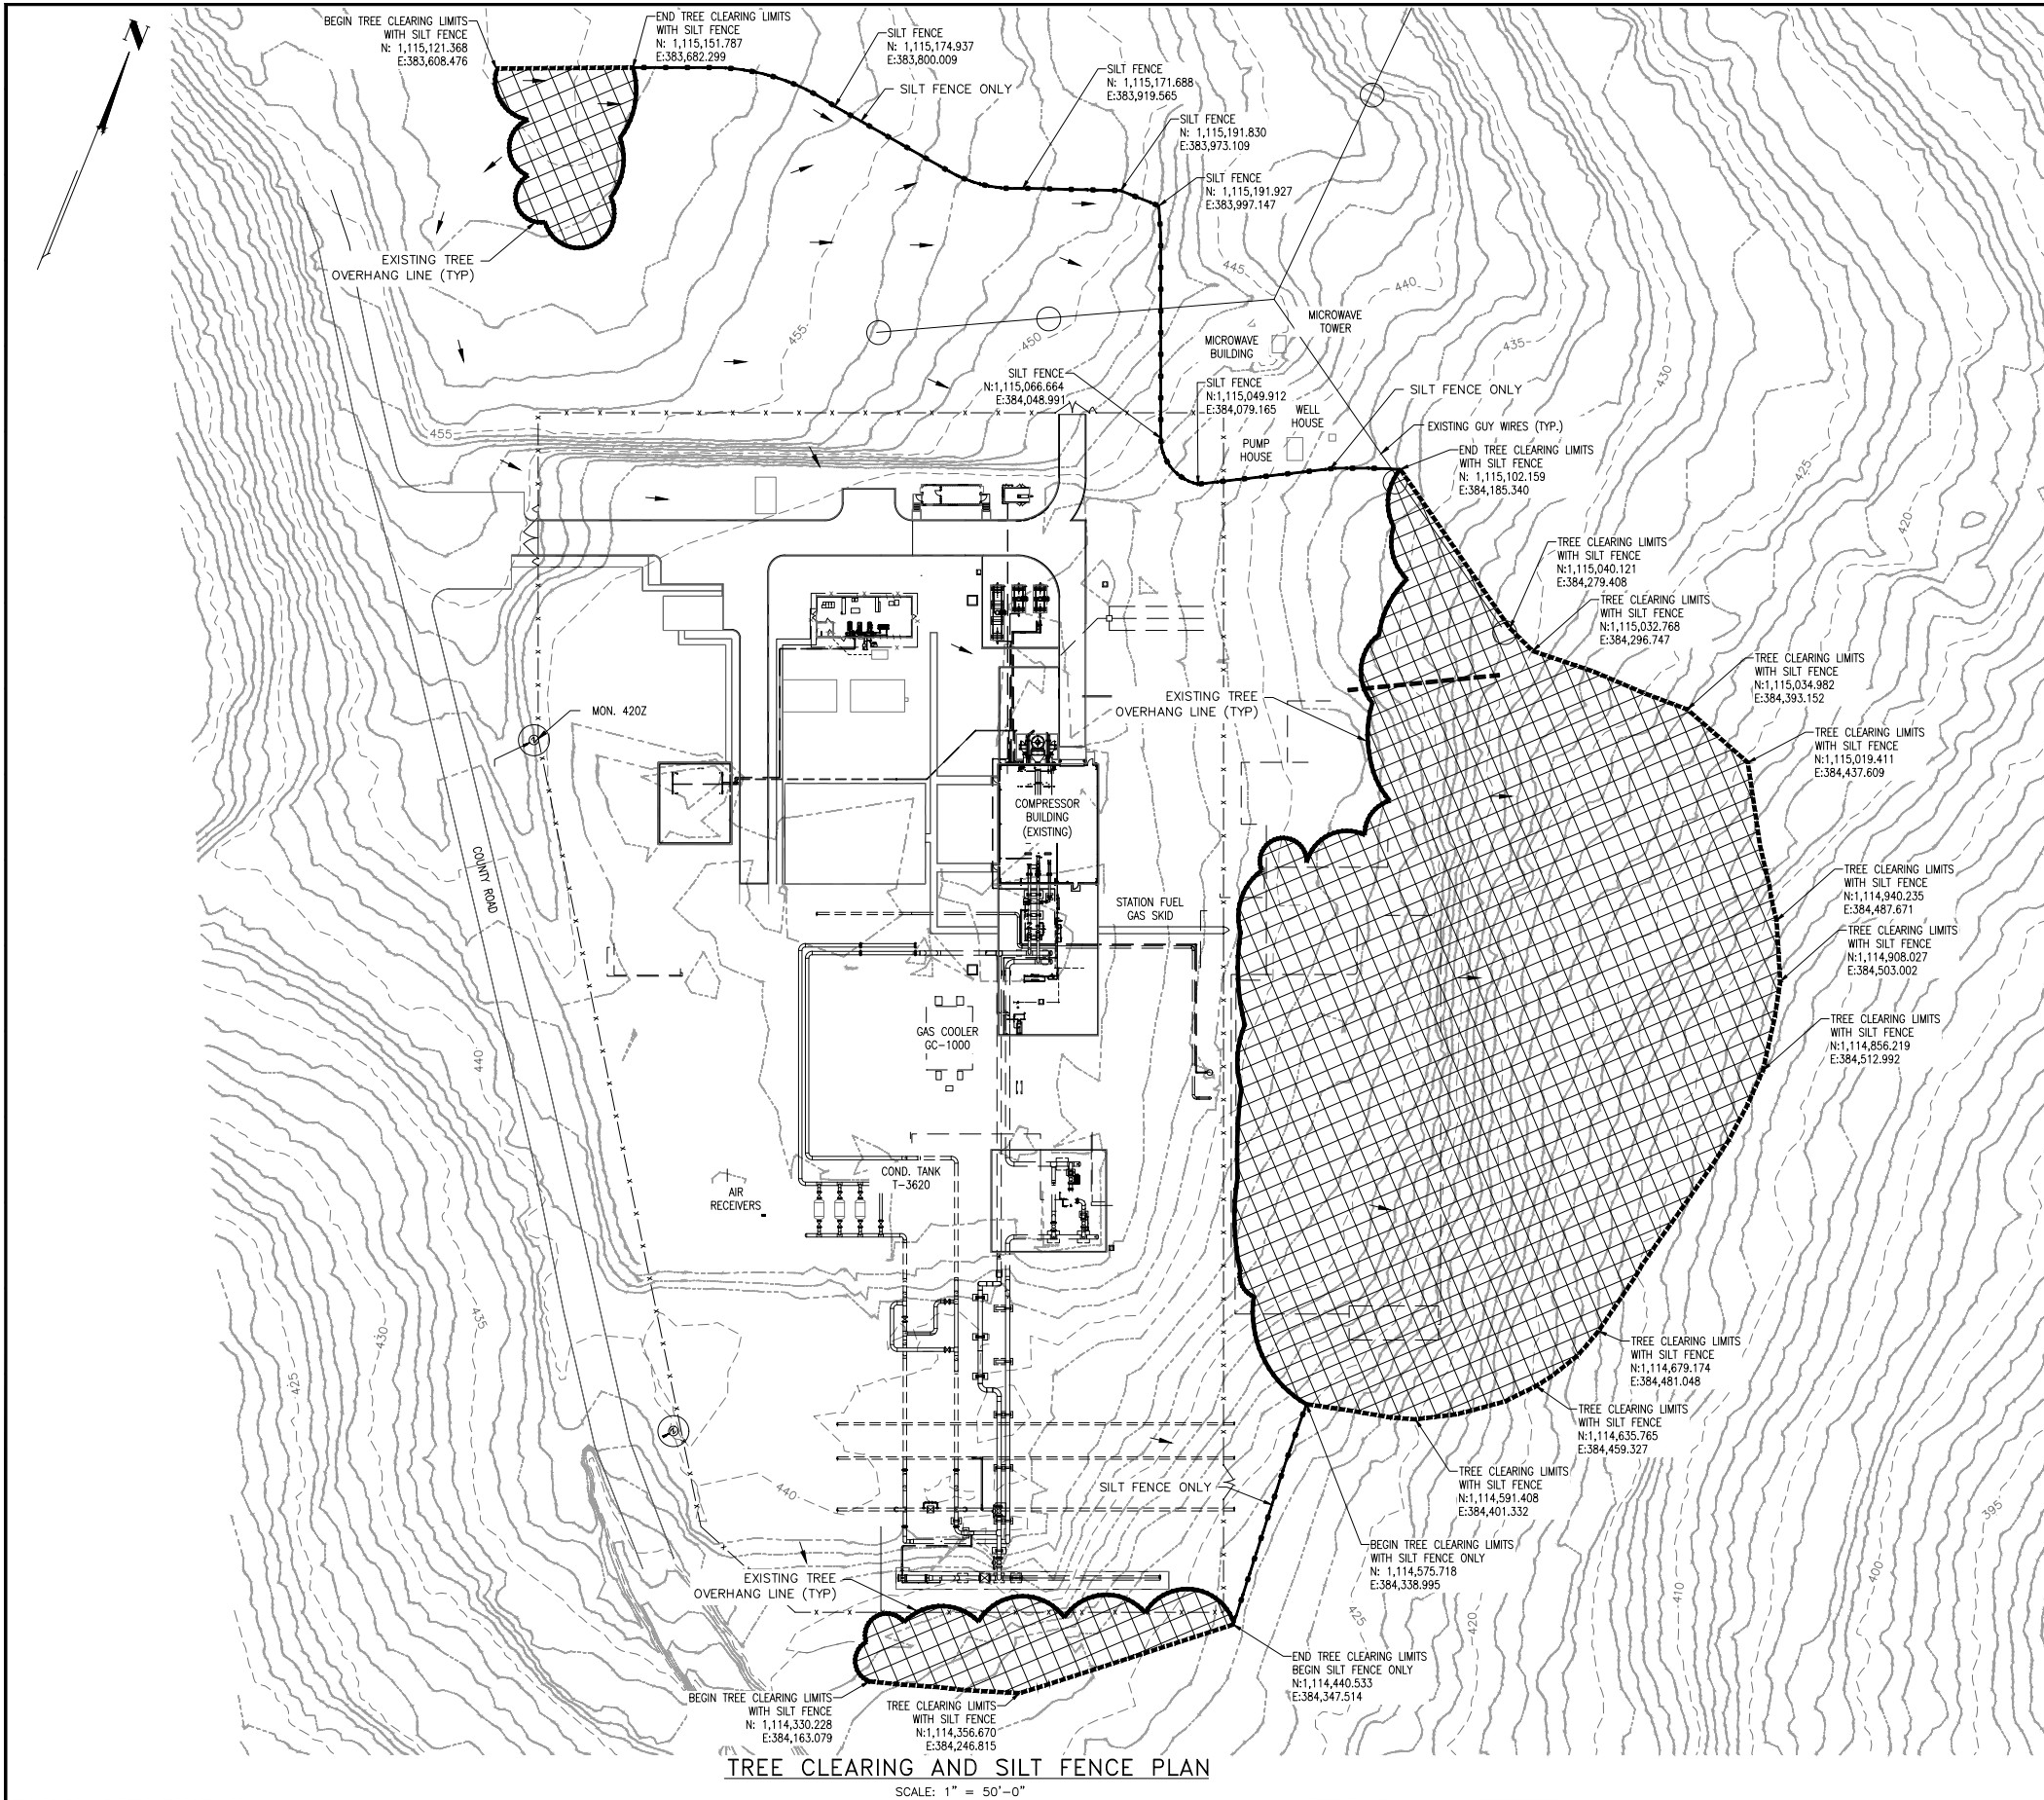

LEGEND

DIRECTION OF FLOW	
EXISTING INDEX CONTOUR	
EXISTING CONTOUR	
EXISTING EQUIPMENT	
PROPOSED INDEX CONTOUR	
PROPOSED CONTOUR	
PROPOSED EDGE OF GRADE	
PROPOSED STONE ROAD	
PROPOSED EQUIPMENT	
PROPOSED PIPELINE	
LIMITS OF CLEARING WITH SILT FENCE	
SILT FENCE	
TREES, TREE OVERHANG AND ROOTS TO BE REMOVED	

NOTES

1. TYPE C SILT FENCE SHALL BE INSTALLED AND MAINTAINED IN ACCORDANCE WITH THE GEORGIA DEPARTMENT OF TRANSPORTATION (GDOT) STANDARD SPECIFICATIONS AND EROSION CONTROL DETAIL DRAWINGS AND THE GEORGIA SOIL AND WATER CONSERVATION COMMISSION (GSWCC) MANUAL FOR EROSION AND SEDIMENT CONTROL IN GEORGIA.
2. TYPE C SILT FENCE SHALL BE 36 INCHES WIDE WITH WIRE REINFORCEMENT OR EQUIVALENT AND IS CLASSIFIED AS A SENSITIVE APPLICATION.
3. TYPE C SILT FENCE SHALL BE USED WHERE RUNOFF FLOWS OR VELOCITIES ARE HIGH OR WHERE SLOPES EXCEED 10 FEET IN VERTICAL HEIGHT.
4. TYPE C SILT FENCE SHALL INCLUDE WOVEN STEEL WIRE REINFORCEMENT OR APPROVED POLYPROPYLENE MESH SUPPORT AND SHALL USE FILTER FABRIC THAT IS AN APPROVED PRODUCT LISTED ON GDOT OPL 36 AND COMPLIES WITH SECTION 881 OF THE GDOT STANDARD SPECIFICATIONS.
5. TYPE C SILT FENCE FILTER FABRIC SHALL MEET GDOT MINIMUM PERFORMANCE REQUIREMENTS FOR TYPE C INCLUDING TENSILE STRENGTH, FLOW RATE, APPARENT OPENING SIZE, ULTRAVIOLET STABILITY, AND BURSTING STRENGTH.
6. WHERE ALL RUNOFF IS STORED BEHIND THE SILT FENCE AND NO STORMWATER DISPOSAL SYSTEM IS PRESENT, MAXIMUM SLOPE LENGTH BEHIND THE FENCE SHALL NOT EXCEED GSWCC REQUIREMENTS AND THE DRAINAGE AREA SHALL NOT EXCEED 1/4 ACRE PER 100 FEET OF SILT FENCE.
7. RIPRAP SPLASH PADS OR OTHER APPROVED OUTLET PROTECTION DEVICES SHALL BE PROVIDED AT LOCATIONS WHERE FLOW MAY OVERTOP THE SILT FENCE. THE MAXIMUM FENCE HEIGHT AT A PROTECTED OUTLET SHALL NOT EXCEED 1 FOOT.
8. SUPPORT POST SPACING SHALL NOT EXCEED 4 FEET FOR TYPE C SILT FENCE. ONLY STEEL POSTS SHALL BE USED FOR TYPE C SILT FENCE INSTALLATIONS. POST INSTALLATION SHALL BEGIN AT THE LOW POINT OF THE FENCE RUN, IF APPLICABLE.
9. SEDIMENT SHALL BE REMOVED WHEN IT REACHES ONE HALF THE ORIGINAL HEIGHT OF THE SILT FENCE. FILTER FABRIC SHALL BE REPLACED WHEN DETERIORATION REDUCES EFFECTIVENESS, GENERALLY AFTER SIX MONTHS.
10. TEMPORARY SILT FENCE SHALL REMAIN IN PLACE UNTIL DISTURBED AREAS ARE PERMANENTLY STABILIZED. ALL ACCUMULATED SEDIMENT SHALL BE REMOVED AND PROPERLY DISPOSED OF PRIOR TO REMOVAL OF THE FENCE.

EROSION PROTECTION QUANTITIES

SINGLE SILT FENCE	L.F.
DOUBLE SILT FENCE	L.F.
VISIBLE DELINEATION FENCE	L.F.

TYPE C SILT FENCE

SCALE: N.T.S.

ISSUED BY:
Waldemar S. Nelson & Co.
FOR APPROVAL
05/08/2026
PRELIMINARY
NOT FOR CONSTRUCTION

			:Reference Drawings		HALL GATE COMPRESSOR STATION:Facility Name	
			PROJECT AFE 239138 SSE 4 EXPANSION - HALL GATE		SITE PLAN - GRADING CLEARING AND GRUBBING	
			KINDERMORGAN SOUTHERN NATURAL GAS		HALL GATE COMPRESSOR STATION BALDWIN COUNTY, GEORGIA	
			WALDEMAR S. NELSON AND COMPANY INCORPORATED ENGINEERS 1200 ST. CHARLES AVE. NEW ORLEANS, LA. GEORGIA LICENSE NO. PE003539 EXPIRATION DATE: JUNE 30, 2026		Status: ISSUED FOR APPROVAL State: GEORGIA PIN No: N/A County: BALDWIN Scale: AS NOTED Category: PLOT PLAN File Name: C-36-101.2.dwg Drawing No: C-36-100.2	
A ISSUED FOR APPROVAL			239138	05-08-2026	Rev A	
Revision Description			Project ID	Date		